



# TIDE Mass\_0

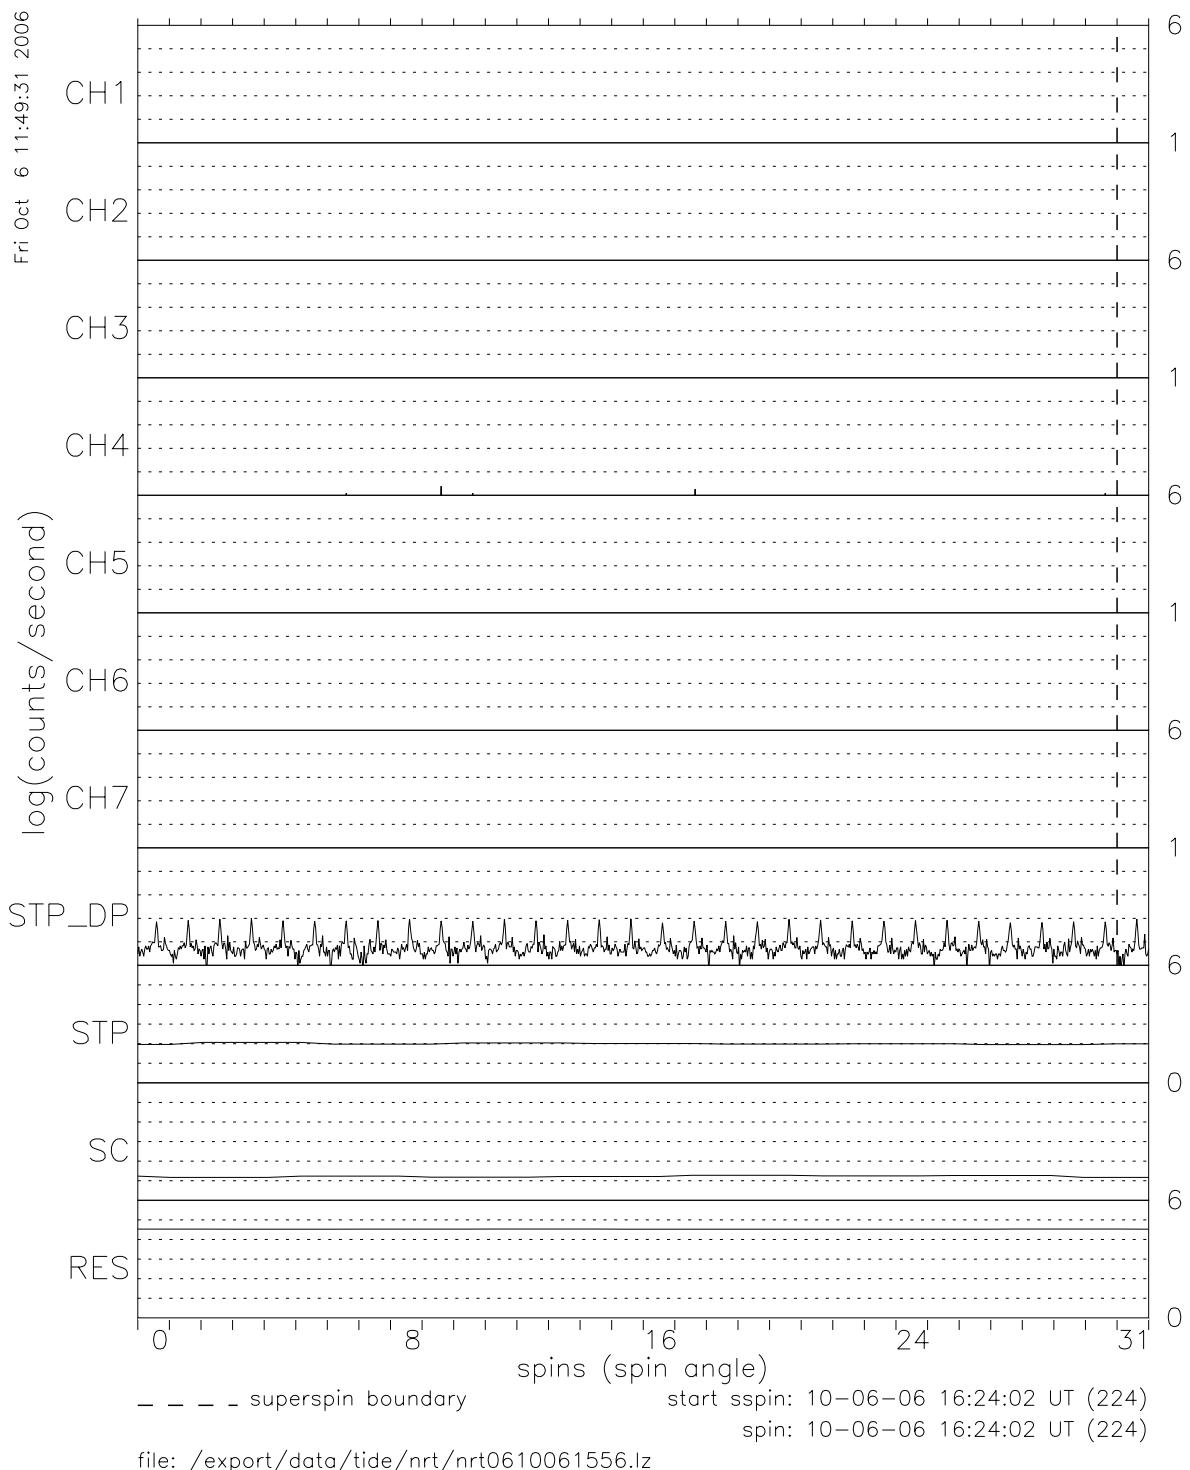

-15kV TOF: -9181 v  
 -3.6kV MCP: -3379 v  
 -2.4kV MCP: -1774 v  
 Input Cur: 308 ma  
 RPA max: 237 v  
 Mirror max: 238 v

Fri Oct 6 11:49:31 2006

## TIDE Direct Events

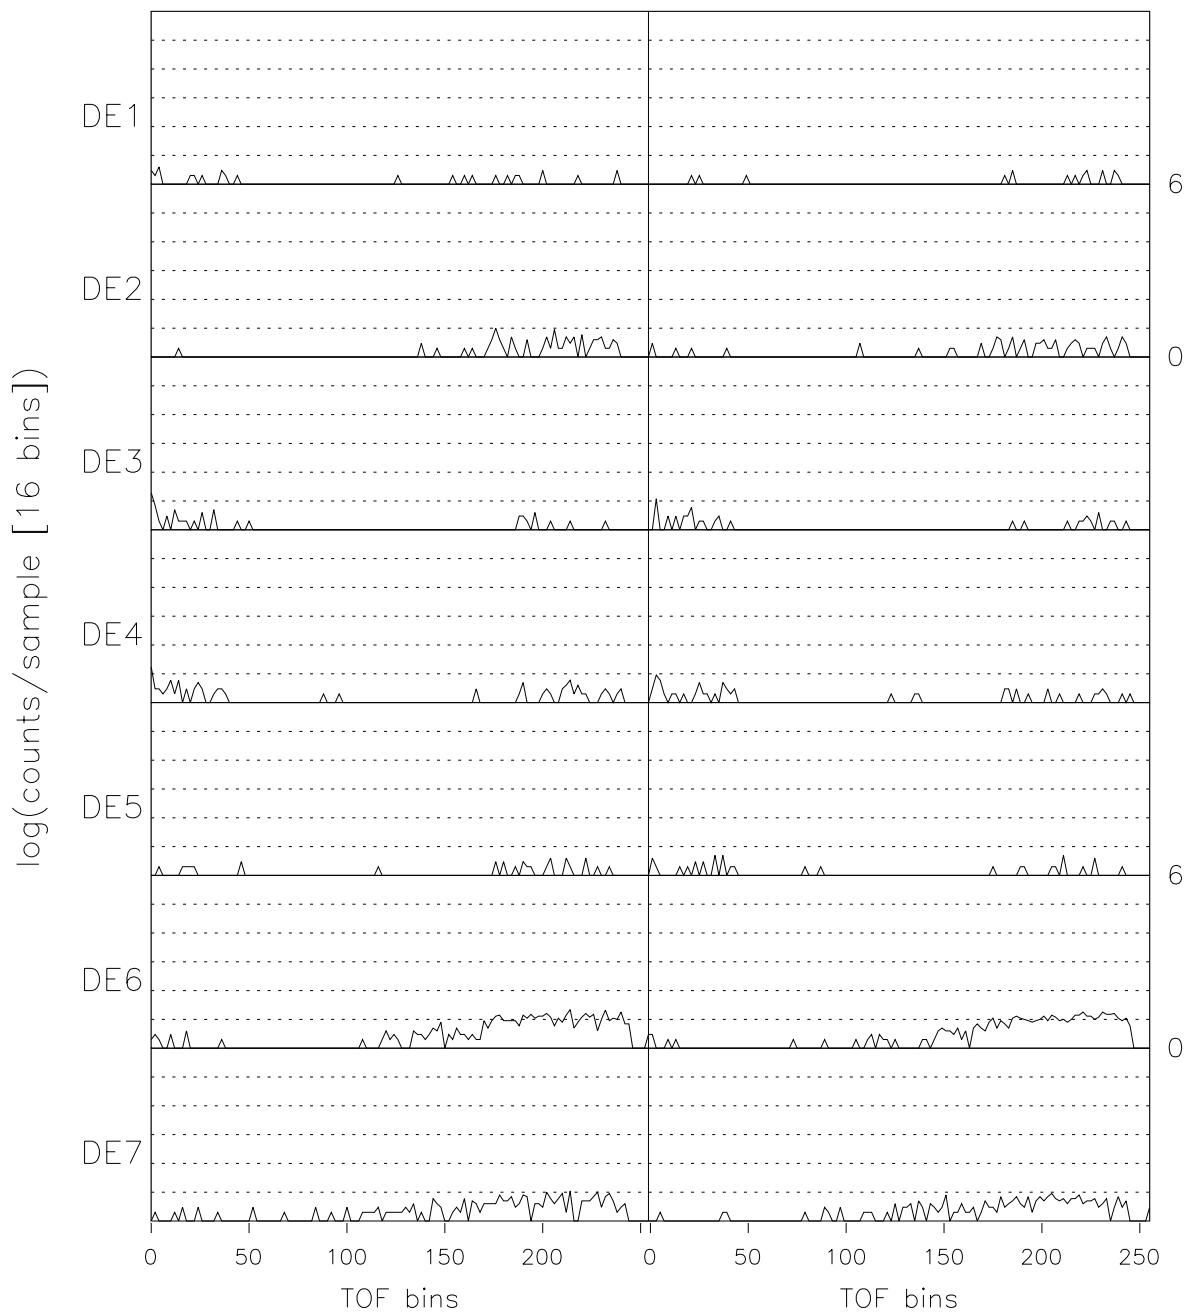

reported: 10-06-06 16:17:32 UT

reported: 10-06-06 16:20:44 UT

file: /export/data/tide/nrt/nrt0610061556.lz

-15kV TOF: -9245 v  
-3.6kV MCP: -3364 v  
-2.4kV MCP: -1774 v  
Input Cur: 308 ma  
RPA max: 237 v  
Mirror max: 238 v